

**ATTAR**

Advanced Technology Testing and Research

ATTAR TEST REPORT NUMBER: 14/7910.2

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025.
Accreditation Number: 2735

26 May 2014

Total Pages: 2**WET SLIP RESISTANCE**

Job No: M14/7910

Prepared for:	Spectrum Floors (Aust) Pty Ltd 8 Selgar Avenue CLOVELLY PARK SA 5042					
Attention:	Brent Hack					
Test Site:	Test Slip Australia Pty Ltd, Beaumont Hills, NSW.					
Test Date:	23 May 2014					
Test Specimens, Size & Quantity:	Artigo Spectrum Granito Dark Grey, 150mm x 300mm, 5 off supplied.					
Sampling & Direction of Testing:	Sampling conducted by client. Test conducted parallel with embossed profile. Refer to Figure 1.					
Test Personnel:	Clark Ahearn					
Preparation:	Washed with water and dried.					
Fixed/Unfixed:	Fixed.					
Air Temperature:	20°C					
Test Equipment:	Wessex Skid Resistance Tester (Pendulum) Serial Number 1818, Calibrated 16/8/2012.					
Test Standard:	AS 4586: 2013 Slip resistance classification of new pedestrian surface materials – Appendix A.					
Slider Rubber:	Slider 96 Batch No. #52 prepared on P400 & 3µm lapping film.					
Classification Criteria:	Refer to Classification Criteria, attached as Appendix 1.					
British Pendulum Number	Specimen Number					SRV
	1	2	3	4	5	
	30	29	30	31	30	30
Classification:	P2					

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

NOTE: Any specimens supplied will be disposed of in two (2) months time, unless otherwise instructed.

ATTAR

Marcus Braché
Senior Engineering Technician
Approved Signatory

This report may not be reproduced, except in its entirety.

ATTAR - Advanced Technology Testing and Research
A division of Engineering Materials Evaluation Pty Ltd ABN 14 006 554 785

Unit 1, 64 Bridge Road, Keysborough Victoria 3173 T (03) 9574 6144 F (03) 9574 6133 E admin@attar.com.au www.attar.com.au

26 May 2014

Total Pages: 2

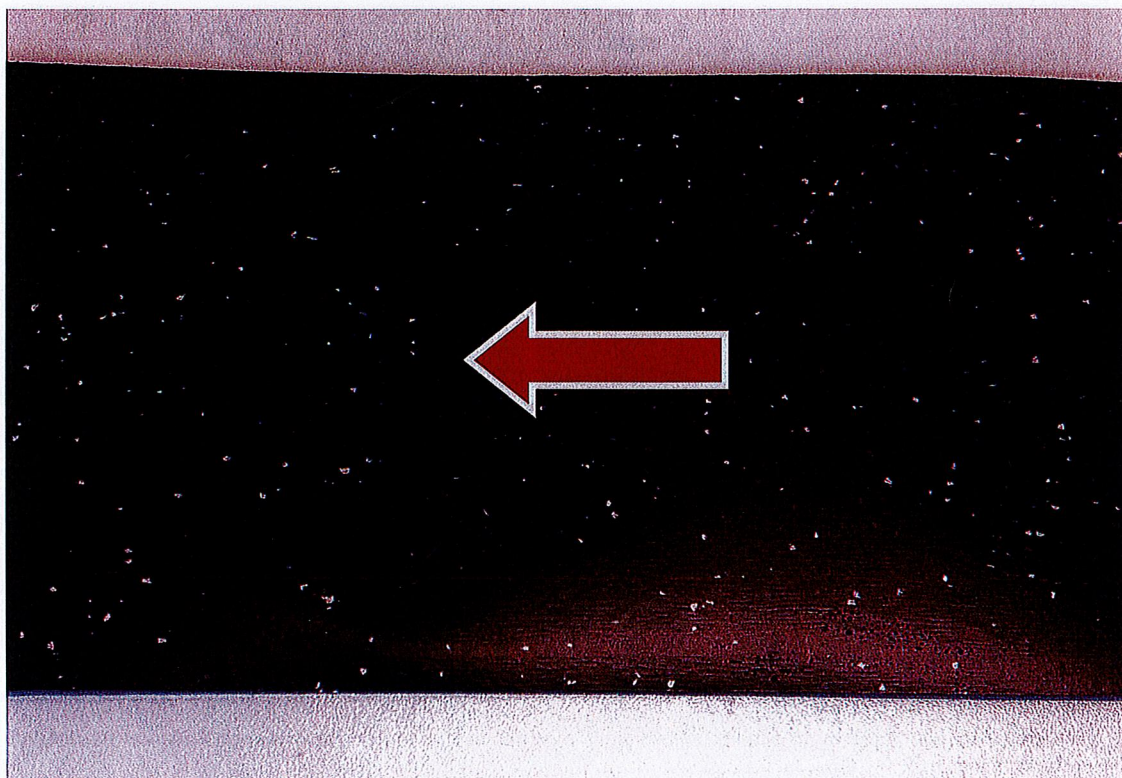


Figure 1: Artigo Spectrum Granito Dark Grey. Highlighted area indicates area tested and direction of test.